



TM

ACOUSTICAL

Sound Solutions for Over 40 Years

SURFACES INC.

Soundproofing | Acoustics | Noise & Vibration Control

Riverbank Acoustical Laboratories (RAL)™ / An Alion Science Technical Center
Laboratory Measurement of Airborne Sound Transmission Loss
of Building Partitions ASTM E 90-04/NVLAP 08/P06

TEST NUMBER: TL10-314 TEST DATE: SEPTEMBER 17, 2010
 CLIENT: Rendered by Manufacturer and Released to: Acoustical Surfaces, Inc.
 123 Columbia Court North, Chaska, MN 55318
 DESIGNATION: GP #3- Steel Stud Gypsum Board Panel
 DIMENSIONS: 47.75" wide x 95.75" high x 4.75" thick
 AREA: 32.0 ft²
 WEIGHT: 164.5 lbs AREA WEIGHT: 5.18 lbs/ft²
 SPECIMEN DETAILS:
 SOURCE ROOM: Room 2 Volume = 6297.6 ft³ Area = 2066.2 ft²
 RECEIVE ROOM: Room 3 Volume = 4929.46 ft³ Area = 1690.3 ft²
 FILE NAME: TL10_314_100917_A.doc

FREQ. (Hz)	T.L. (dB)	UNC. (dB) 95%CL	DEF. (dB) <CONT	FREQ. (Hz)	T.L. (dB)	UNC. (dB) 95%CL	DEF. (dB) <CONT
100	21	0.75		800	49	0.16	
125	28	0.42	1	1k	50	0.21	
160	27	0.93	5	1.25k	50	0.12	
200	35	0.41		1.6k	48	0.10	1
250	39	0.50		2k	41	0.12	8
315	36	0.37	5	2.5k	44	0.10	5
400	41	0.37	3	3.15k	47	0.08	2
500	44	0.21	1	4k	51	0.06	
630	45	0.24	1	5k	52	0.07	

Sound Transmission Class (STC) = 45

Total Deficiencies = 32

Extended Frequency Data

FREQ.	T.L.	UNC.	DEF.	FREQ.	T.L.	UNC.	DEF.
80	8	0.85					

R: 44
OITC: 27

Test Conducted by *Marc Sciak*
Marc Sciak

This single report page and accompanying graph contain the instantaneous raw data as provided to the client after testing of the specimen. This data, although accurate, is incomplete without the full specimen description, mounting details and signature pages. The full report referenced by the RAL test number above should be consulted for further information regarding these results.



STOP NOISE

TM


ACOUSTICAL

Sound Solutions for Over 40 Years

SURFACES INC.

Soundproofing | Acoustics | Noise & Vibration Control

**SOUND TRANSMISSION REPORT
RAL - TL10-314**

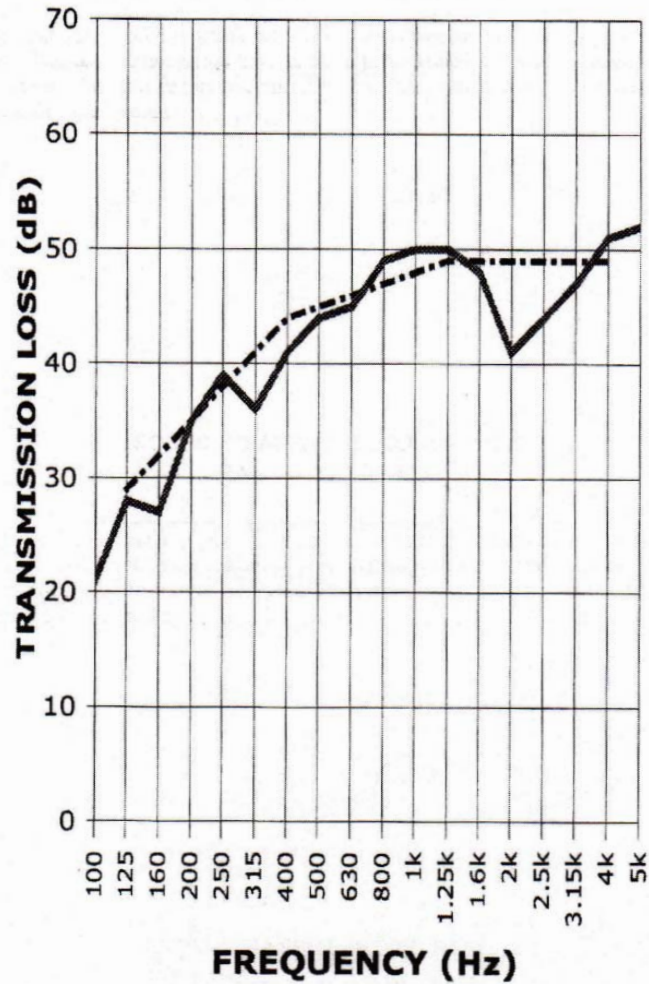

FREQUENCY (Hz)

STC = 45



TRANSMISSION LOSS
SOUND TRANSMISSION LOSS CONTOUR